



SILVER LAKE INFLOW POINTS

1. Highway 21 Culvert connecting Silver Lake and Irogami.
 - a. Concrete Lip on Silver Lake side is 867.41 ft
 - b. Concrete Lip on Irogami side is 867.61 ft
 - c. Water normally flows from Irogami into Silver when conditions warrant

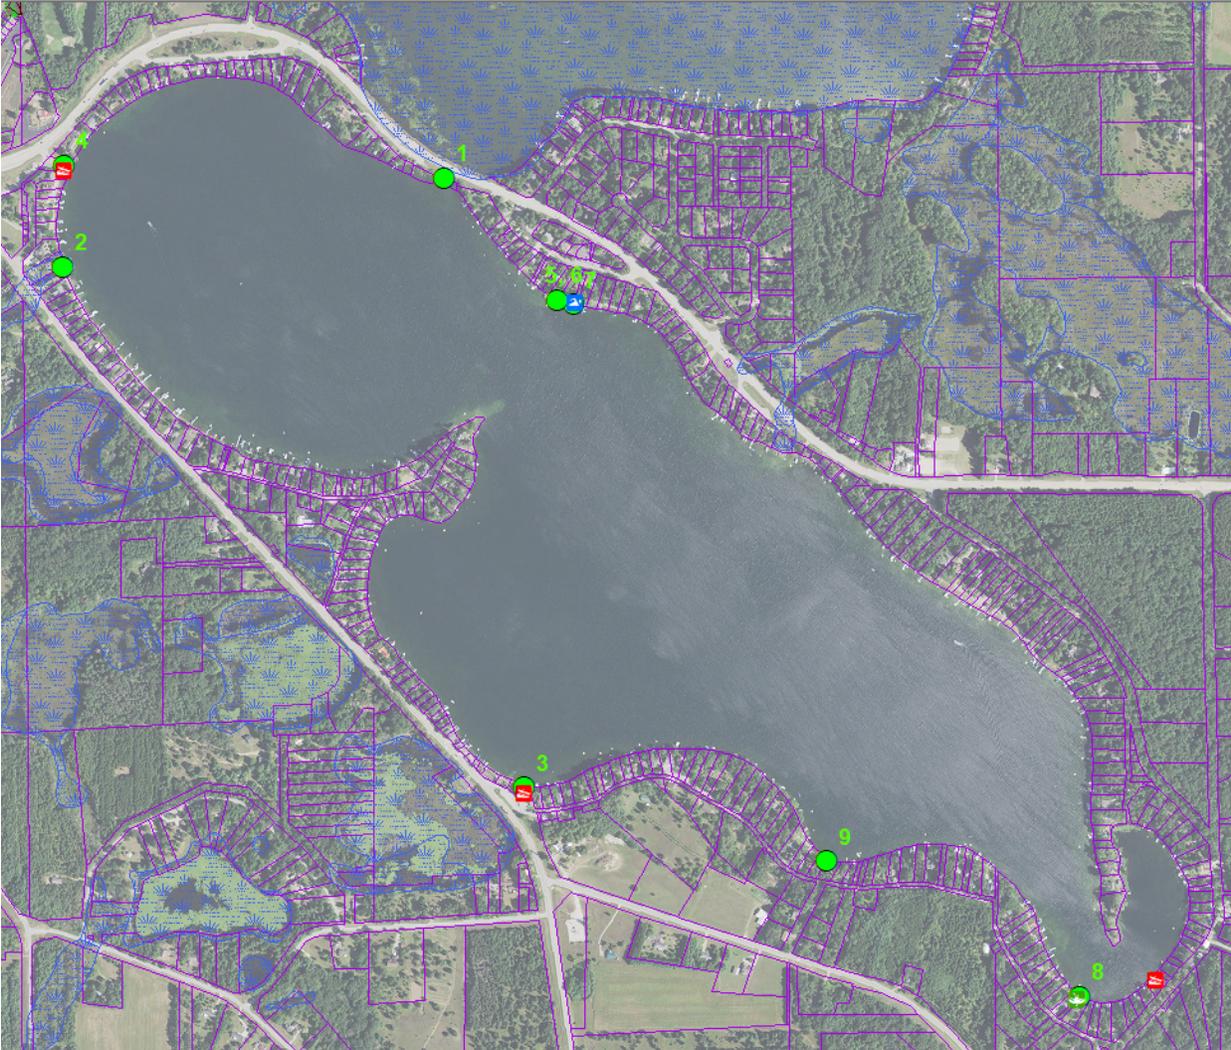

SILVER LAKE INFLOW POINTS

2. 24" Highway 73 culvert from Booth's Marsh.
 - a. Under highway 73, just east of Hwy 21 and 73 stoplights
 - b. Water from Booths Marsh flows into Silver
 - c. Flow into Silver Lake is consistent. Heavy rainfall you can notice a plume of Booth's marsh water from the discharge pipe into the lake.
 - d. Discharge into the lake is located between the residences on N2022 AND N2211 State Highway 73.

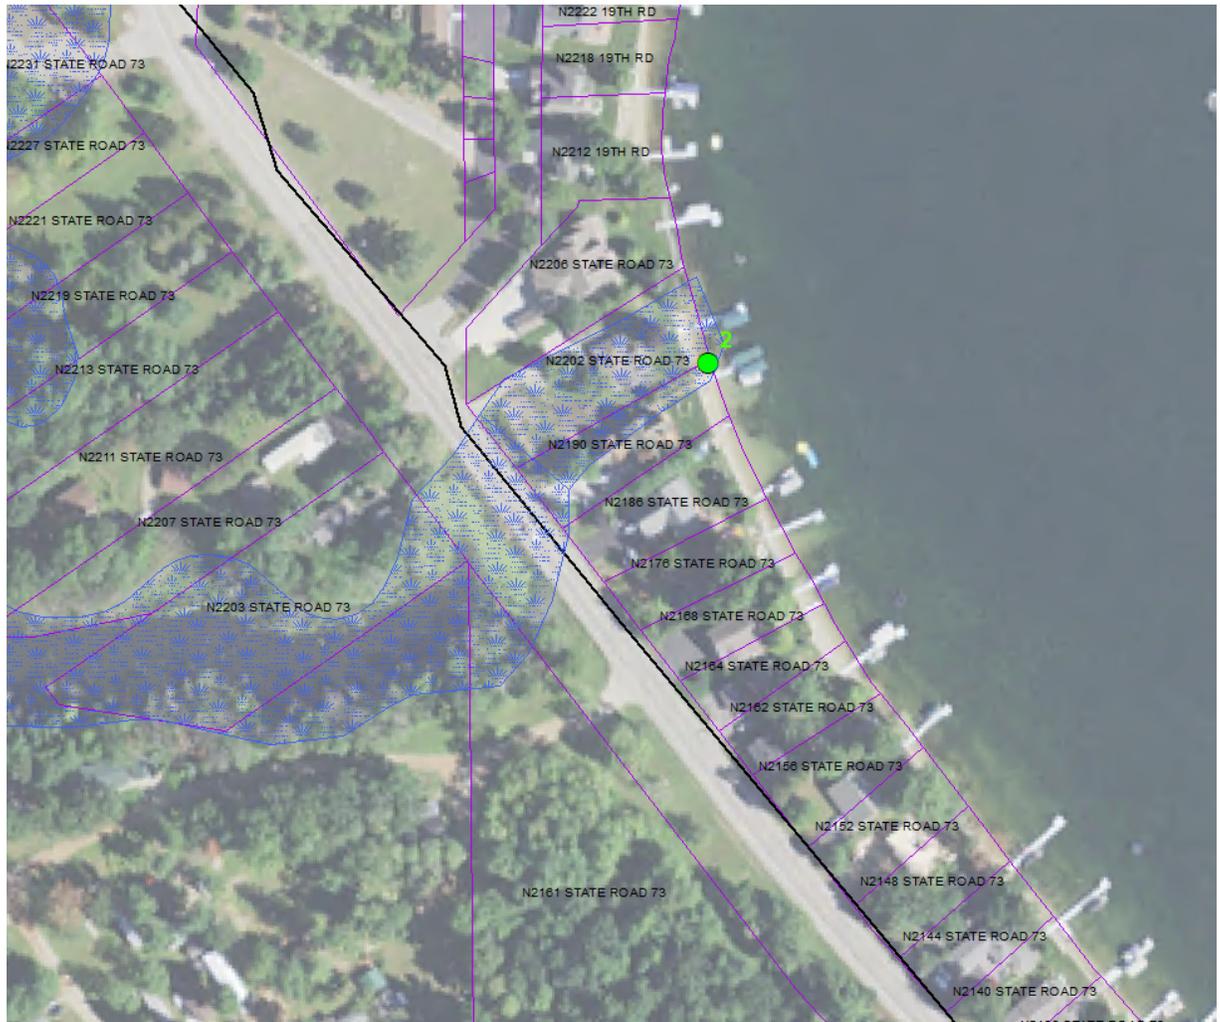

SILVER LAKE INFLOW POINTS

3. Highway 73 boat landing.
 - a. Asphalt parking lot drains into Culvert on west side of ramp into lake.
 - b. Also handles approximately 1,000 ft of runoff from S. Silver Lake Road which flows into trailer parking lot.



SILVER LAKE INFLOW POINTS

4. Highway 21 and 73 boat landing.
 - a. Culvert outlet on north side of ramp approximately halfway down ramp.
 - b. Catch basin handles runoff from paved ramp and turn around area and sand car/trailer parking area.



SILVER LAKE INFLOW POINTS

5. Catch basin on Silvercryst Road, behind W7029 Silvercryst Road which handles the runoff from Silvercryst Parking lot and Silvercryst Avenue. A small catch basin and 4" pipe inlet handle runoff from the Silvercryst kitchen driveway and land swallow (west of Silvercryst). A manhole on the east side of W7029 Silvercryst on the adjacent property provides connection points of small catch basin and 4" pipe to 12" pipe flowing into the lake. The 12" discharge into the lake is on the east side of the W7029 property. In storm events, this discharge produces considerable runoff into the lake.
6. Small 12x12 catch basin in Land swallow on the west side of 7029 property handles drainage from swallow between 7029 and 7031 Silvercryst Avenue. Discharge into lake is a 4" pipe. Rarely this inlet flows, water is usually absorbed into the ground first.
7. Silvercryst has a concrete apron and pipe in the middle of the beach area centered on the building. This apron handle runoff from the Silvercryst Motel area lawn, parking lot, and asphalt path down to the lake between the restaurant and motel. Runoff which is not directed into inlet 1 flows down this path.




(see clarification on #5, #6 above and below)

SILVER LAKE INFLOW POINTS



8. Town of Marion public access area on Silver Lake Road. Stairway to lake is located just east of W6764 S Silver Lake Road. There is rip rap under the stairs and platforms which allows runoff from South Silver Lake Road to cascade down into the lake.

SILVER LAKE INFLOW POINTS

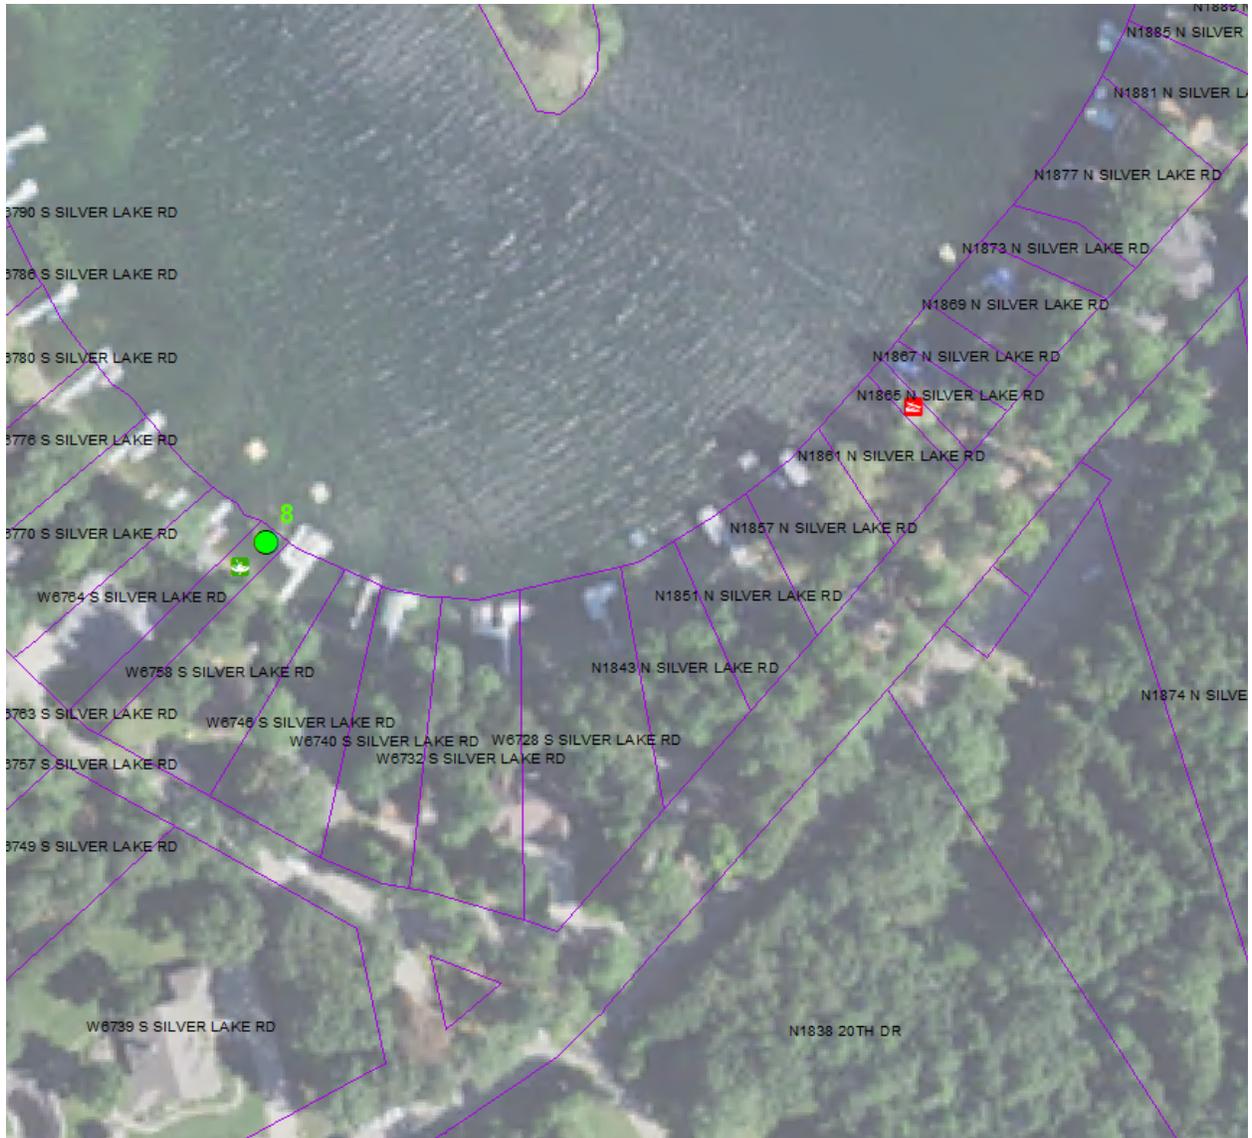

SILVER LAKE INFLOW POINTS

- Catch basin on the intersection of Silver Oaks Court and South Silver Lake Road. Street runoff is carried from there into a plastic culvert draining into the lake. Inflow from the pipe to the lake is the east side of the boat house located on the property at W6096 S Silver Lake Road.

